

ADMINISTRATION  
BUILDING




ISSUED	REV	DATE
DART Submittal		15 May 2015
Site Development Plan 1		23 June 2015
30% Schematic Design		30 Oct. 2015
Pre-App & Architectural Board of Review Submittal		23 Apr. 2016
Architectural Board of Review Submittal		25 Jan. 2017
Architectural Board of Review Submittal		10 OCT 2022
Building Permit Review		28 AUG 2023




- KEY NOTES**
- 3"x3"x3/8" ALUMINUM 'EGG CRATE' SHADE GRILLE, ON 3/4"x4 1/2"x1/8" ANGLES, ATTACHED TO 2'X8" HSS HORIZONTAL SUPPORT STRUCTURE.
  - 2'X2' ACOUSTICAL TILE CEILING 'CLOUDS', SUSPENDED INDEPENDENTLY. (SEE SPECIFICATIONS) CENTER TILE IN 'CLOUD,' IN BOTH DIRECTIONS
  - 2'X2' SUSPENDED ACOUSTICAL TILE CEILING (SEE SPECIFICATIONS). ASTERISK \* DESIGNATES STARTING POINT OF GRID.
  - BRACE FRAMED 5/8" GYPSUM BOARD CEILINGS AND SOFFITS
  - SUSPENDED LINEAR WOOD CEILING, WITH 4" STEPS
  - REFLECTIVE 'TUBULAR' SKYLIGHTS WITH ROUND DIFFUSER WHERE STRUCTURE IS EXPOSED
  - REFLECTIVE 'TUBULAR' SKYLIGHTS WITH SQUARE CEILING DIFFUSER.
  - 5/8" MOISTURE, MOLD, AND MILDEW REISTANT GYPSUM BOARD SOFFIT.


**1 REFLECTED CEILING PLAN**  
1/4" = 1'-0"

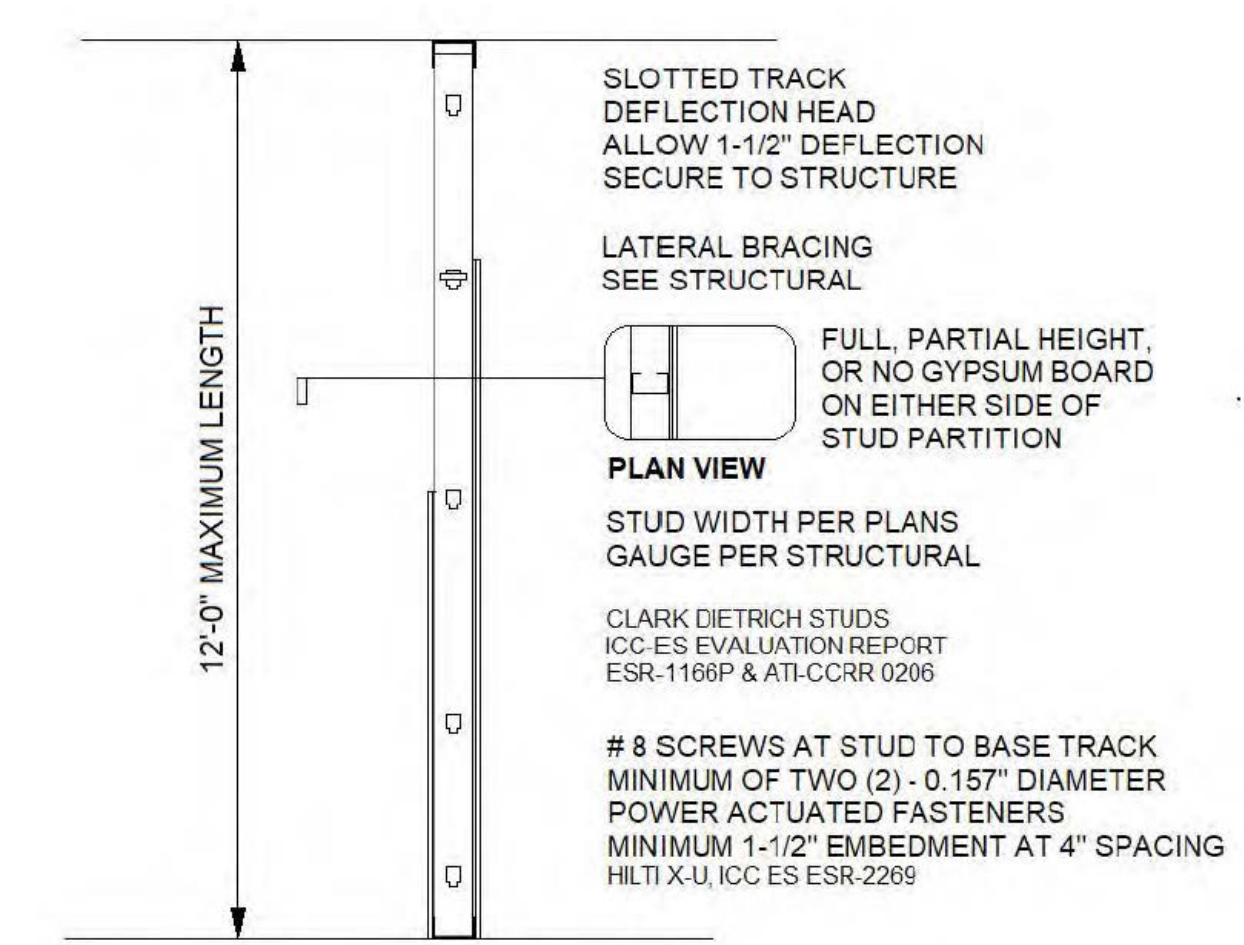



**A. NON-COMPOSITE FRAMING SECTION**

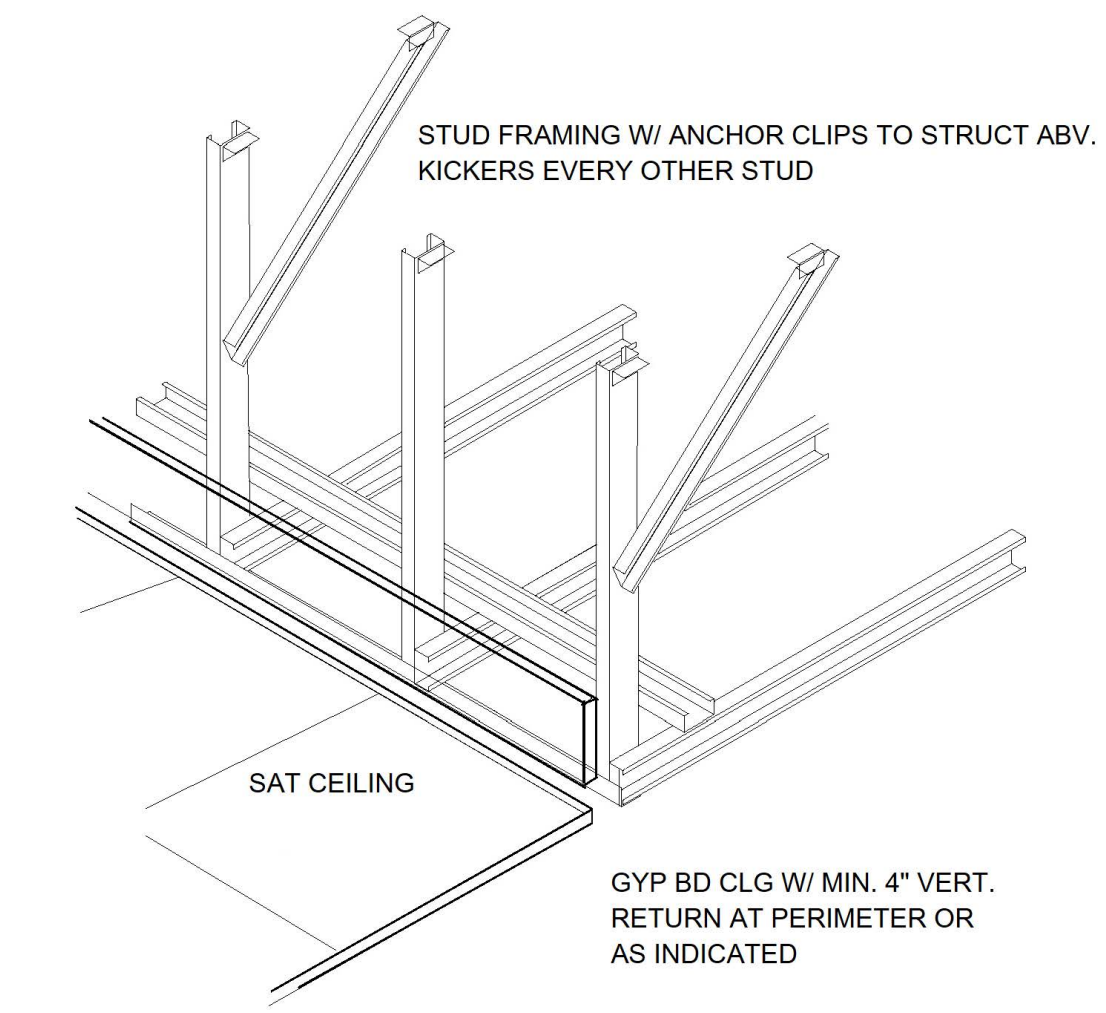

**B. FRAMED CEILING DETAIL**  
3" = 1'-0"

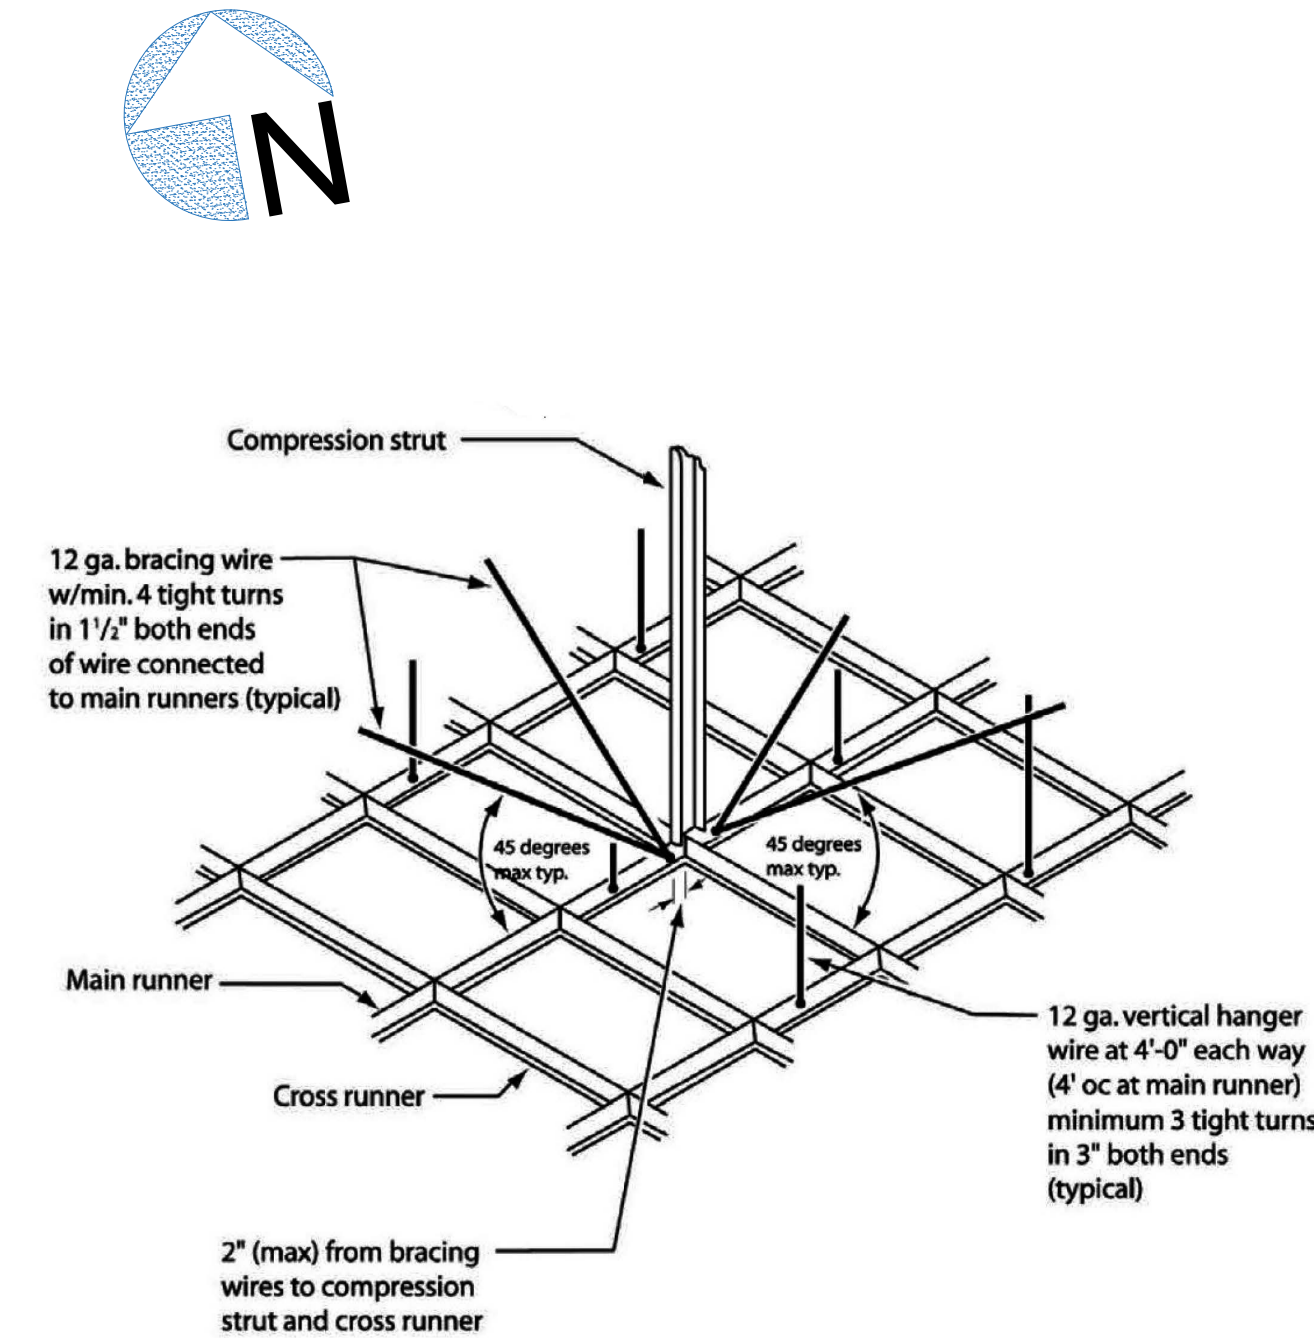

**C. SUSPENDED CEILING SEISMIC BRACING**

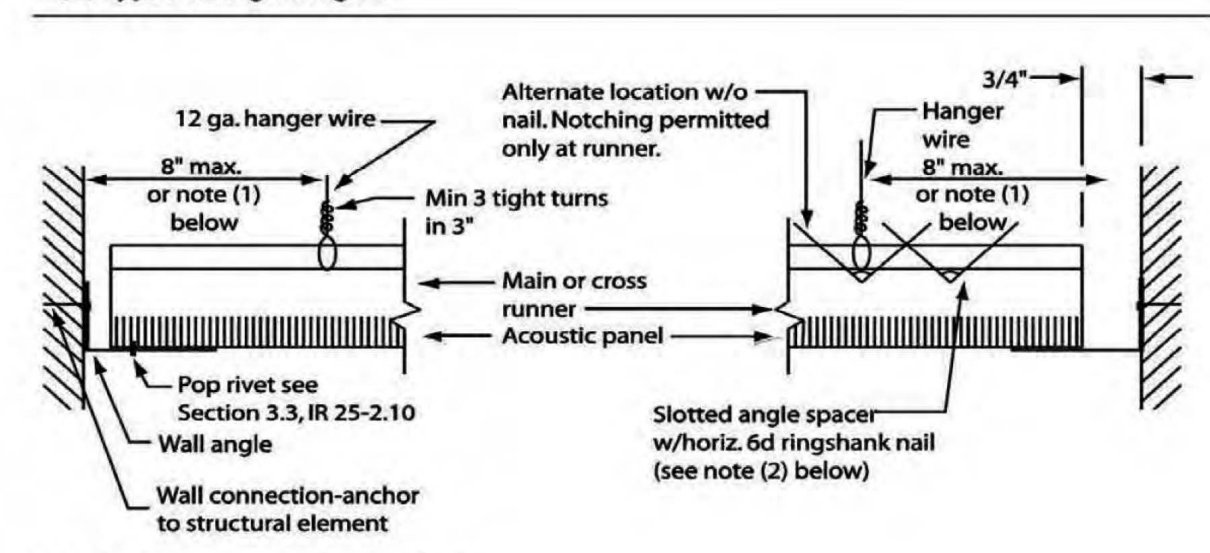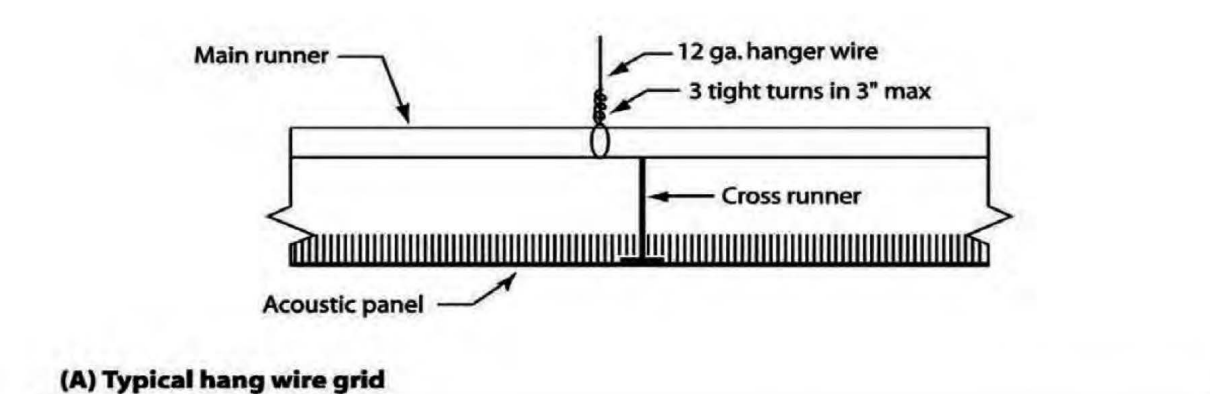

- (B) Perimeter details - typical**
- Notes:
- 1/4 of the length of the end runner whichever is less.
  - Nails at the end of horizontal struts are to be placed with nail head toward centerline of span of strut.
  - Hanger wire not required for cross runners less than 8" long between main runner and wall.

**D. SUSPEND CEILING SEISMIC BRACING**